


**Induction Coil Type
Anti-Sidetone Subset**

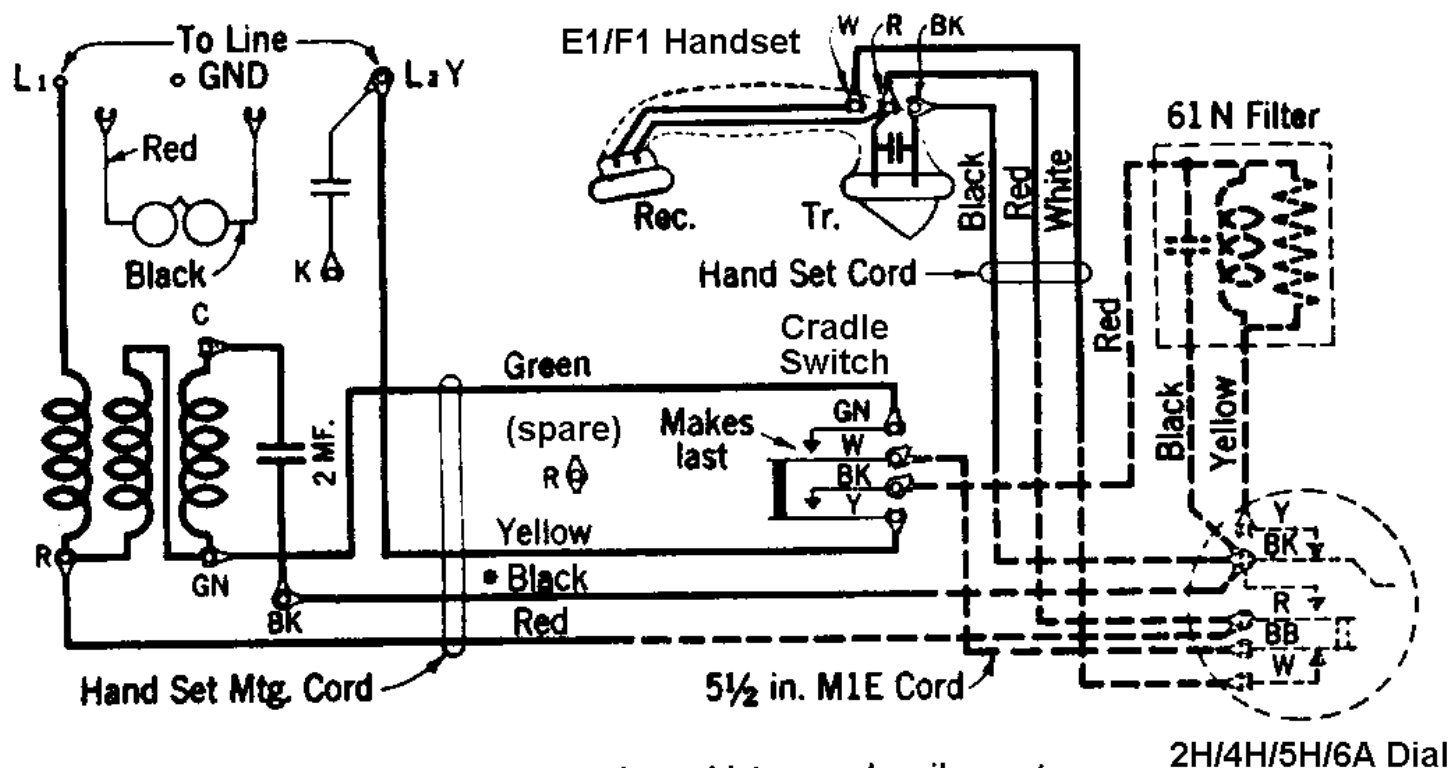

Note: • Not used when connected to sidetone subscriber set.

**102 & 202 Type Hand Tel. Sets Equipped with Dial & Filter
Shown with Anti-Sidetone Induction Coil Type Subset**

**102 type sidetone hand tel. sets use 3 cond. mounting cord &
295A/534A/584A subset for sidetone service.**

**3 cond. mtg cord MUST be replaced with 4 cond.
for use w/ anti-sidetone subsets.**

**202 Type anti-sidetone hand tel. sets use 4 Cond. mounting cord &
295A/534A/584A subset for sidetone service or
634A/BA or 684A/BA/BC subsets for antisidetone service**

Derived from C63.323 Issue 3 10-4-2003 Stephen Kerman